

# CASE STUDY



## The Aquarium Pyramid at Moody Gardens installs Flux Drive ASD Energy savings will recoup investment in 14 months

*The motor and pump are both operating at noticeably lower temperatures with the Flux Drive ASD installed, and the noise and vibration are substantially reduced, compared to the adjacent pumps. This will also reduce our maintenance costs and improve the overall reliability of these pumps.*

– Greg Whittaker  
Animal Husbandry Manager  
Moody Gardens Aquarium

*In addition to the energy savings, there are many indirect benefits that we'll realize over time with reduced wear on bearings, less frequent seal replacement, and fewer issues associated with chronic vibration.*

– Roy Drinnen  
Assistant Curator of Fishes  
Moody Gardens Aquarium

# Pyramid Aquarium at Moody Gardens

## CASE STUDY

In February of 2010 Flux Drive personnel installed a Flux Drive Adjustable Speed Drive (ASD) at the Moody Gardens Aquarium in Galveston, Texas with the goal of evaluating the potential cost savings and operational improvements that an ASD can offer over existing throttle valve control systems. The ASD was installed on a 50 HP motor which drives the pump providing filtration flow for the Caribbean exhibit.



Built in 1999, the Pyramid Aquarium at Moody Gardens is a 1.5 million-gallon aquarium and a tribute to the North Pacific, Caribbean, Tropical Pacific and South Atlantic Oceans. The facility features close-up views of penguins, sharks, seals, sea horses, moray eels and much more. Moody Gardens hosts over two million guests a year and is an active participant in a waste water recovery project and has several initiatives to become a leader in sustainability efforts.



Moody Gardens  
Galveston Island, Texas




Pyramid Aquarium  
at Moody Gardens

Improving energy efficiency is a high a priority for Moody Gardens. Finding solutions that work in the harsh saltwater environment while maintaining the aquarium's critical life support exhibits has been difficult.

### Challenge:

When the aquarium was built in 1999, the designers chose to install multiple motors, pumps and control valves to regulate the water flow through the critical sand filter applications supporting the sea life in the large saltwater aquariums. Filter flow control was maintained by throttling back the valves while keeping all the pumps running. Unfortunately, using throttling valves for flow control has proven to have several drawbacks including poor energy efficiency. Reliability was also a concern since the pump room is located in a damp and often wet environment that had even flooded during recent hurricanes. With all this in mind, the electronic VFD was just not an option for this critical application.

Due to the high monthly energy costs to run each motor driven filter pump (approximately \$18,000/year) the Moody Gardens facility management team had been actively researching ways to reduce the power consumption for this critical filtering application. After observing an installation of a Flux Drive ASD operating in a damp and flood prone environment at the Houston Zoo, the Moody Gardens staff decided to evaluate a Flux Drive ASD running on one of their filter pump applications.

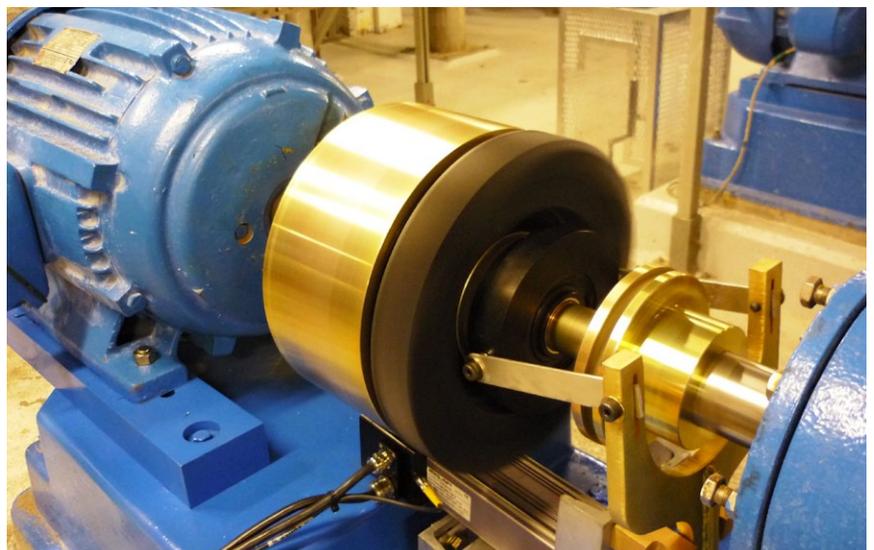

Flux Drive Adjustable Speed Drive running on  
a filter pump application at Moody Gardens



Original system layout with LimiTorque® control valve



Flux Drive ASD Model 10 – 150 (50 hp) filter pump application at Moody Gardens

Moody Gardens has five (5), 1500 gpm — Ingersoll-Dresser filter pumps (Model GRP 8 x 6 x 13) and ten (10) Neptune - Benson sand filters servicing the Caribbean exhibit to provide continuous filtration. The aquarium exhibit is designed to have one pump provide water to two sand filters rated at a maximum flow rate of 750 gpm each. Filter flow is adjusted by one LimiTorque® control valve located at the pump discharge. A back-wash procedure on the sand filters occurs once per week and requires full flow during that operation.

The Flux Drive team acquired condition readings on the original motor / pump installation and recorded energy usage, pump flow rates, vibration and operating temperatures of the motor and pump. It was quickly determined that the flow control provided by the LimiTorque® control valve was extremely limited and provided almost no energy savings. This was also confirmed by reviewing the pump design curves provided by the OEM, Ingersoll-Dresser Pumps.

Initial vibration levels measured on the motor and pump were elevated due to misalignment and associated looseness. The 'as found' motor to pump misalignment was 91.5 mils vertically and 23.1 mils horizontally. Cavitation and noise levels on the pump were noticeable and attributed to the LimiTorque® valve being partially closed. The Energy levels were measured on the motor controller at the standard operating pressure / flow as follows: 1) operating wattage with the control valve throttled at 60% closed was 31.8 kW, 2) motor current 43.7 amps, and 3) 2.4% THD (Total Harmonic Distortion, current). The output pump pressure was measured at 28.5 psig with a flow rate of 1575 gpm. The motor had a relatively hot stator frame temperature of 153 degrees F and the pump was also elevated to 111 degrees.


### Solution:

A Flux Drive ASD (Model 10-150) fitted with an Exlar linear actuator was selected for this 50 hp installation allowing for fully automatic control (with a 4 – 20 ma signal). The original motor to pump shaft distance with a Love Joy flexible coupling installed was 4 inches. This required that the motor be moved back 8 inches to accommodate for the Flux Drive ASD (Model 10-150) to be installed. Foundation spacer rails were utilized for relocating the motor outboard and the Flux Drive ASD was installed between the motor and the pump.


Alignment of the Flux Drive was also completed using the supplied .050" plastic shim spacers located in the air gap to verify adequate gap between the induction rotor and magnet assembly in the four clock positions. A visual inspection and equal gaps of the flexible coupling hub also confirms when the alignment is acceptable. There is no need to align using laser optical alignment equipment.

*continues on back*

**Infrared MOTOR temperatures before and after flux drive install**

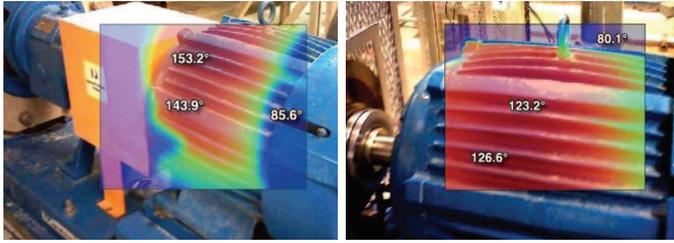

**Infrared PUMP temperatures before and after flux drive install**

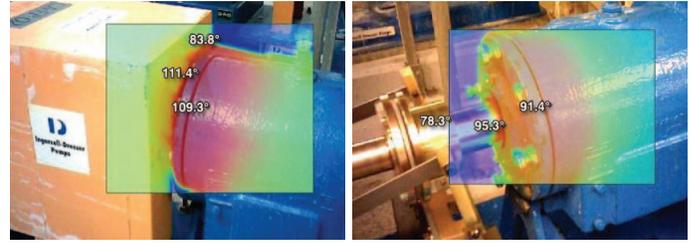

The final alignment of the Flux Drive ASD at Moody Gardens was recorded and documented as follows:

6.0 mils vertically and 4.4 mils horizontally. The allowable misalignment for the Flux Drive ASD or Coupling is noted to be 15 mils or less (for 1800 rpm) for this 10-150 ASD model.

Once the installation was completed, the pump discharge valve was fully opened to allow for full unrestricted flow past the valve. The Flux Drive team then started the motor and reacquired the power and condition readings on the new Flux Drive adjustable speed installation.

Overall vibration levels on the motor and pump were noted to be reduced by a factor of three (3) when compared at full speed/power. The vibration at 1 x SS were less than 0.04 in/sec horizontally, and 0.03 in/sec in the vertical and axial directions on the motor and less than 0.03 in/sec horizontally, 0.02 in/sec vertically and 0.02 in/sec axially on the pump.

With the pump flow rate reduced by the Flux Drive ASD to 1200 gpm at 1503 rpm, cavitation on the pump was eliminated and noise levels fell significantly. The motor frame housing temperature was also reduced from 153 to 126 degrees F and the pump bearing temperature was reduced from 110 to 95 degrees F. Power measurements were recorded using the Fluke 345 power quality meter and found to have reduced from 31.8 kW (using a throttling valve) to just 21.5 kW using the Flux Drive ASD, resulting in a 33% energy savings (or \$5,865/year). Additional savings could also be realized by reducing the pump flow rate even further as the exhibit filter requirements permit.

**Summary:**

With the proven 33% energy savings from the successful implementation of two Flux Drive Adjustable Speed Drives, Moody Gardens is now in the process of procuring three additional Flux Drive Adjustable Speed Drives for the remaining motor/pump systems at the Pyramid Aquarium.

Energy Savings Summary Table								
Power Comparison	Full Power	Test 2	Test 3	Test 4	Test 5	Test 6	Test 7	Test 8
Filter Pump No. 2					New Set Point		Additional Savings	
Motor RPM	1784	1786	1788	1789	1789	1790	1791	1792
Pump RPM	1768	1670	1603	1546	1502	1493	1386	1332
Motor Power - Kwatts	31.8	27	24.5	22.5	21.5	20.9	17.61	16
<b>KW Savings %</b>	<b>0</b>	<b>15.63%</b>	<b>23.44%</b>	<b>29.69%</b>	<b>32.81%</b>	<b>34.69%</b>	<b>44.97%</b>	<b>50.00%</b>
<b>\$ Savings / Yr (0.065 \$/KwH)</b>	<b>0</b>	<b>\$2,733.12</b>	<b>\$4,156.62</b>	<b>\$5,295.42</b>	<b>\$5,864.82</b>	<b>\$6,206.46</b>	<b>\$8,079.79</b>	<b>\$8,996.52</b>
Motor - Amps	43.7	39	35.6	33.3	32	31.5	28.1	26.4
Pump - Flow (gpm)	1575	1440	1356	1250	1200	1150	1080	1008
Pump/Filter - Influent (psig)	28.5	27	26.5	25.5	25.5	25	24.5	23
Pump/Filter - Effluent (psig)	21.5	21.5	21.5	21.5	21.5	21.5	21.5	21.5



Flux Drive Inc. 14209 - 29th Street East Suite 105 Sumner, Washington 98390  
 Phone: 253.826.9002 Fax: 253.826.9004 Web: www.fluxdrive.com



The Flux Drive name and logo are registered trademarks of Flux Drive Inc.



The Aquarium Pyramid name and the Moody Gardens name and logo are trademarks of Moody Gardens, a public, non-profit educational destination utilizing nature in the advancement of rehabilitation, conservation, recreation, and research.